

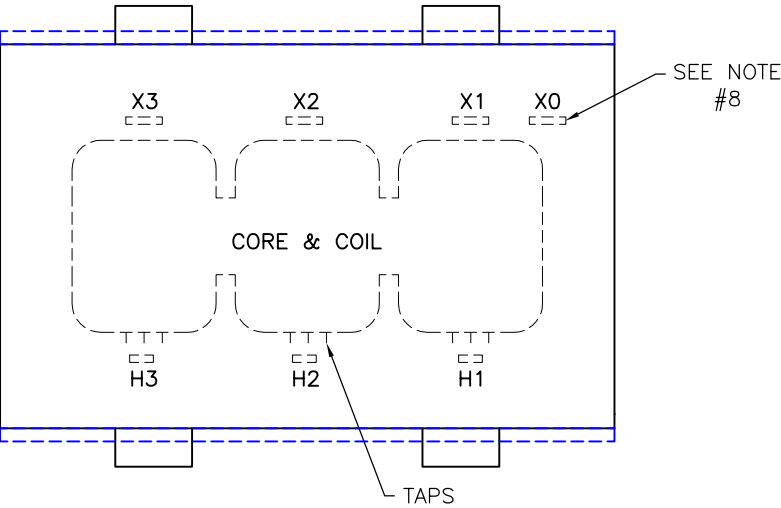
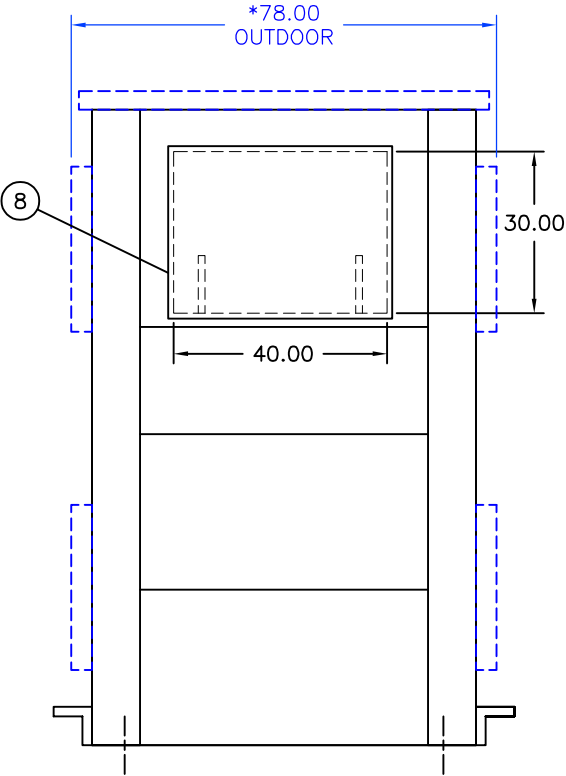


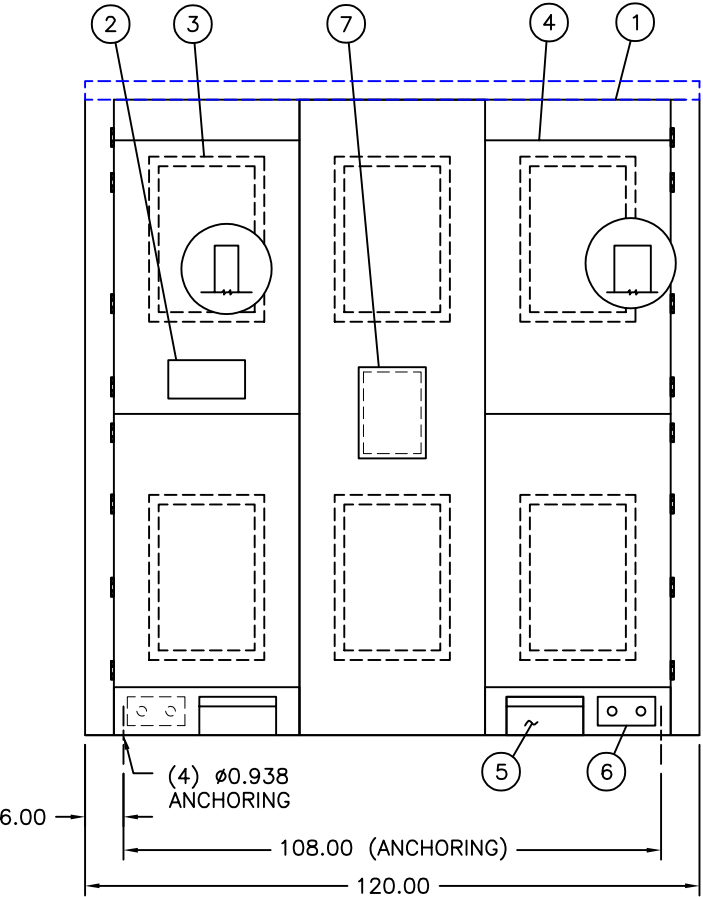

FOR REFERENCE ONLY

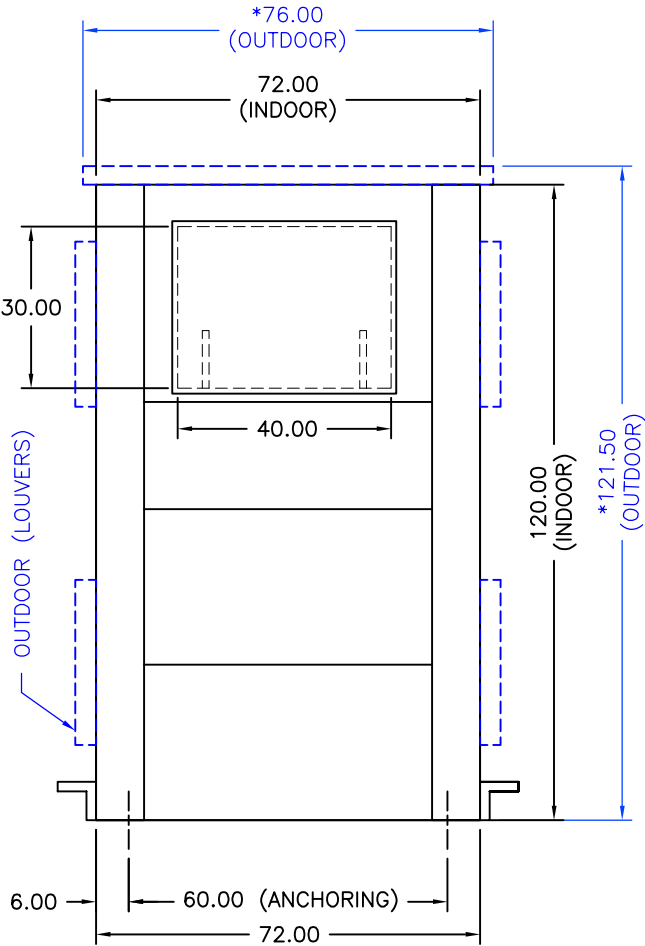

LEGEND		
ITEM	QTY	DESCRIPTIONS
1	3	TOP COVER - REMOVABLE - FLUSH FOR INDOOR, *CAPPED FOR OUTDOOR
2	1	DIAGRAMATIC NAMEPLATE
3	12	VENT - SCREEN FOR INDOOR / LOUVERS FOR OUTDOOR
4	6	FRONT & REAR PANEL - (4) HINGED PANELS
5	4	JACK PAD - REMOVABLE
6	2	GROUND PAD - STAINLESS STEEL
7	1	PROVISION FOR TEMP. MONITOR
8	2	CABLE / BUS ENTRY CUTOUT W / BOLTED COVER

NOTES
1) THIS DRAWING IS NOT FOR CONSTRUCTION PURPOSES.
2) K FACTOR MIGHT CHANGE CASE DIMENSION.
3) TRANSFORMERS ARE MANUFACTURED AND TESTED PER APPLICABLE ANSI, NEMA AND IEEE STDS, LATEST REVISION.
4) UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN INCHES WITH ± 0.25" TOLERANCE.
5) TRANSFORMER IS U.L. LISTED.
6) TRANSFORMER NOT TO BE INSTALLED IN PUBLIC ACCESS AREAS OTHERWISE IT MUST BE FENCED OR ISOLATED.
7) WEIGHTS, DIMENSIONS & CONSTRUCTION MAY CHANGE WITHOUT PRIOR NOTICE.
8) FOR LV WYE CONNECTION ONLY.

S.O. NO: —

DWG FOR: ☐ RECORD ☐ APPROVAL ☐ QUOTE

CUST/JOB NAME: -

CUST ORDER NO: -

SERIAL NO: -

ID TAG: -

KVA: -

HIGH VOLTAGE: -

LOW VOLTAGE: -

HV TAPS: -

HV-KV BIL: -

LV-KV BIL: -

PHASE: -

FREQ-HZ: -

TEMP RISE-°C: -

COOLING CLASS: -

INSULATION CLASS: -

WINDING COND: -

PAINT/COATING: -

APPRX WT-LBS: -

HV COORD: -

LV COORD: -

	PAGE 1 OF 1	SCALE: NONE	TITLE: DRY TRANSFORMER OUTLINE --- DRY TYPE UNIT SUBSTATION	
	BY	DATE		
	MECH: LU	06/18/26		
	ELECT:			
REVISIONS	APPD:			

CAD NO. 12012072U -

REV. -