
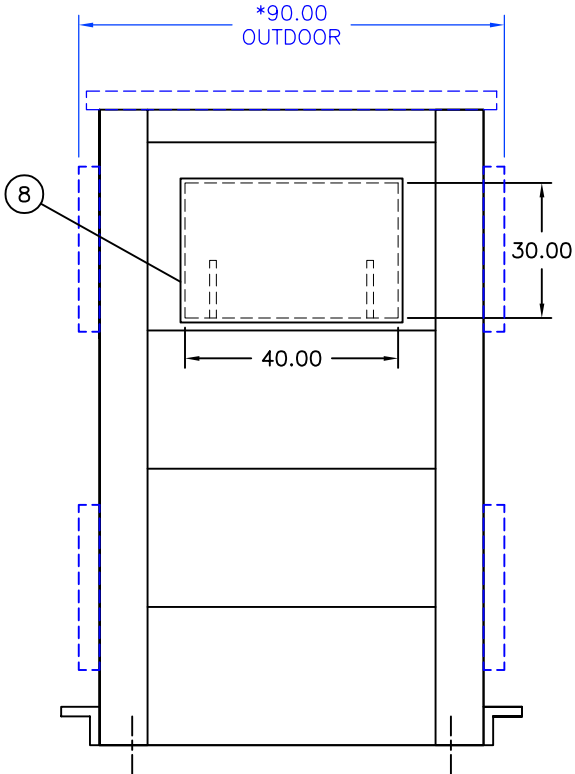
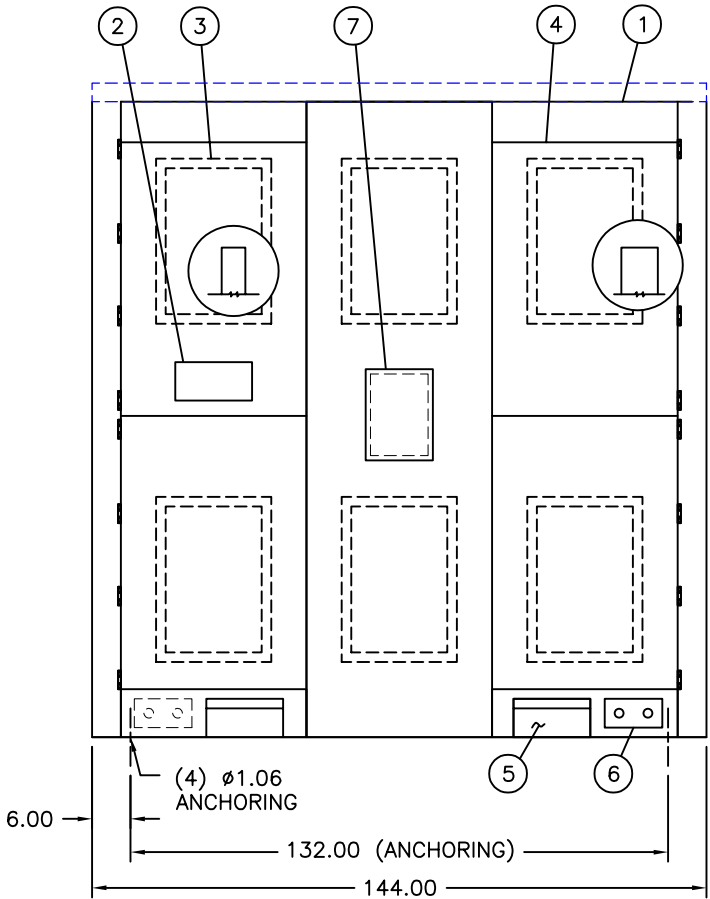
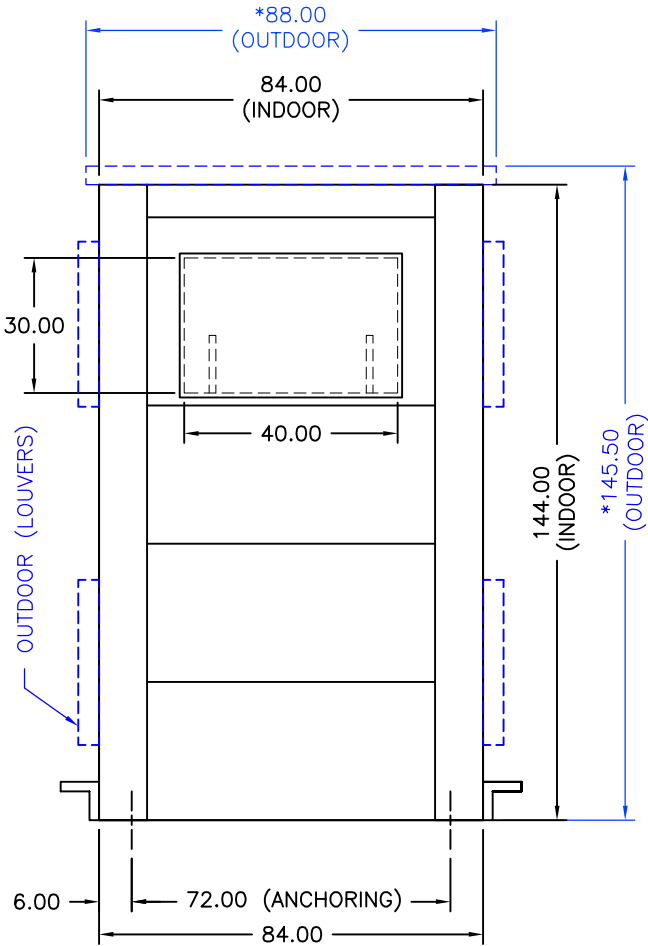


LEGEND		
ITEM	QTY	DESCRIPTIONS
1	3	TOP COVER - REMOVABLE - FLUSH FOR INDOOR, *CAPPED FOR OUTDOOR
2	1	DIAGRAMATIC NAMEPLATE
3	12	VENT - SCREEN FOR INDOOR / LOUVERS FOR OUTDOOR
4	6	FRONT & REAR PANEL - (4) HINGED PANELS
5	4	JACK PAD - REMOVABLE
6	2	GROUND PAD - STAINLESS STEEL
7	1	PROVISION FOR TEMP. MONITOR
8	2	CABLE / BUS ENTRY CUTOUT W / BOLTED COVER

FOR REFERENCE ONLY

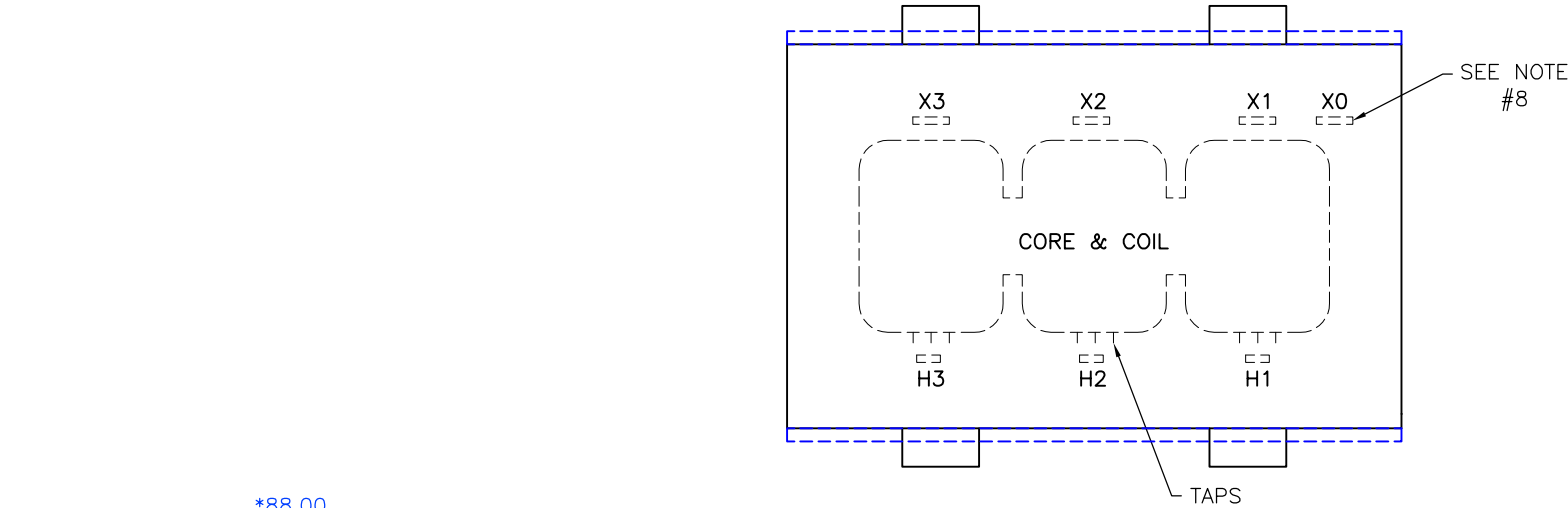

- NOTES
- 1) THIS DRAWING IS NOT FOR CONSTRUCTION PURPOSES.
- 2) K FACTOR MIGHT CHANGE CASE DIMENSION.
- 3) TRANSFORMERS ARE MANUFACTURED AND TESTED PER APPLICABLE ANSI, NEMA AND IEEE STDS, LATEST REVISION.
- 4) UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN INCHES WITH ± 0.25" TOLERANCE.
- 5) TRANSFORMER IS U.L. LISTED.
- 6) TRANSFORMER NOT TO BE INSTALLED IN PUBLIC ACCESS AREAS OTHERWISE IT MUST BE FENCED OR ISOLATED.
- 7) WEIGHTS, DIMENSIONS & CONSTRUCTION MAY CHANGE WITHOUT PRIOR NOTICE.
- 8) FOR LV WYE CONNECTION ONLY.

S.O. NO: —
DWG FOR: ☐ RECORD ☐ APPROVAL ☐ QUOTE
CUST/JOB NAME: -
CUST ORDER NO: -
SERIAL NO: -
ID TAG: -
KVA: -
HIGH VOLTAGE: -
LOW VOLTAGE: -
HV TAPS: -
HV-KV BIL: -
LV-KV BIL: -
PHASE: -
FREQ-HZ: -
TEMP RISE-°C: -
COOLING CLASS: -
INSULATION CLASS: -
WINDING COND: -
PAINT/COATING: -
APPRX WT-LBS: -
HV COORD: -
LV COORD: -

		PAGE 1 OF 1	SCALE: NONE	TITLE: DRY TRANSFORMER OUTLINE --- DRY TYPE UNIT SUBSTATION			
		BY	DATE				
		MECH: LU	06/18/26		MGM TRANSFORMERS BY FORGENT	CAD NO. 14414484U	REV. -
		ELECT:					
REVISIONS		APPD:					