

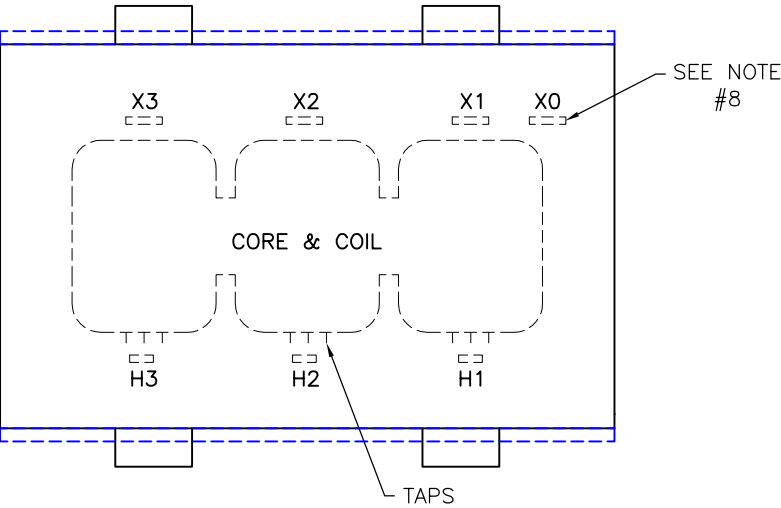
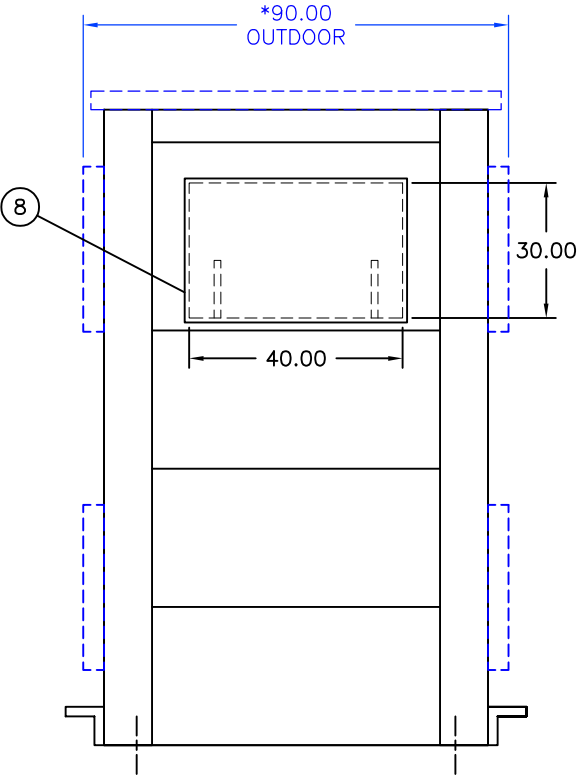


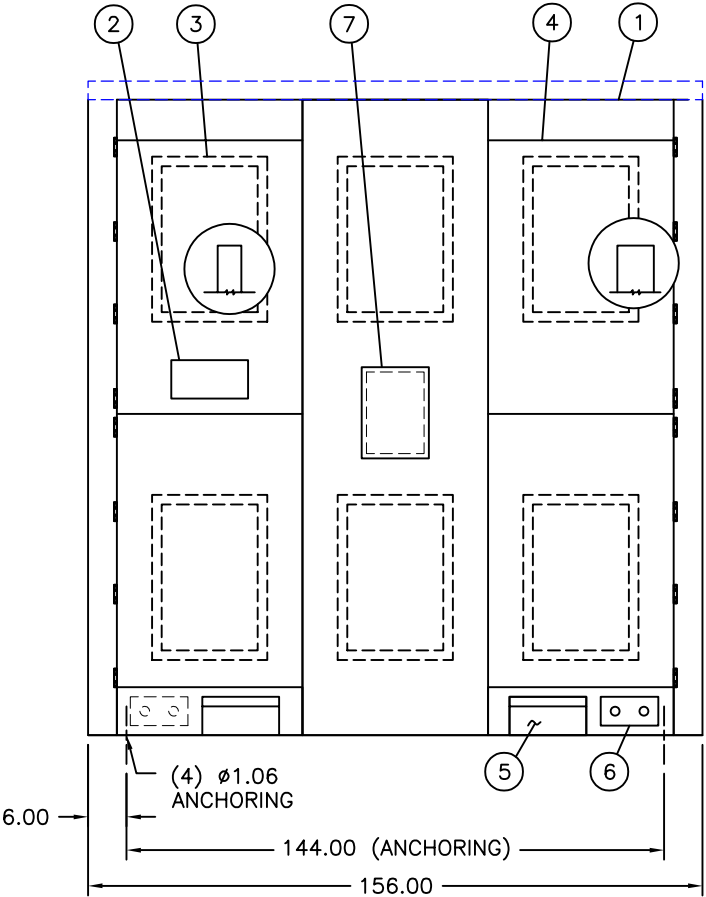

FOR REFERENCE ONLY

LEGEND		
ITEM	QTY	DESCRIPTIONS
1	3	TOP COVER - REMOVABLE - FLUSH FOR INDOOR, *CAPPED FOR OUTDOOR
2	1	DIAGRAMATIC NAMEPLATE
3	12	VENT - SCREEN FOR INDOOR / LOUVERS FOR OUTDOOR
4	6	FRONT & REAR PANEL - (4) HINGED PANELS
5	4	JACK PAD - REMOVABLE
6	2	GROUND PAD - STAINLESS STEEL
7	1	PROVISION FOR TEMP. MONITOR
8	2	CABLE / BUS ENTRY CUTOUT W / BOLTED COVER

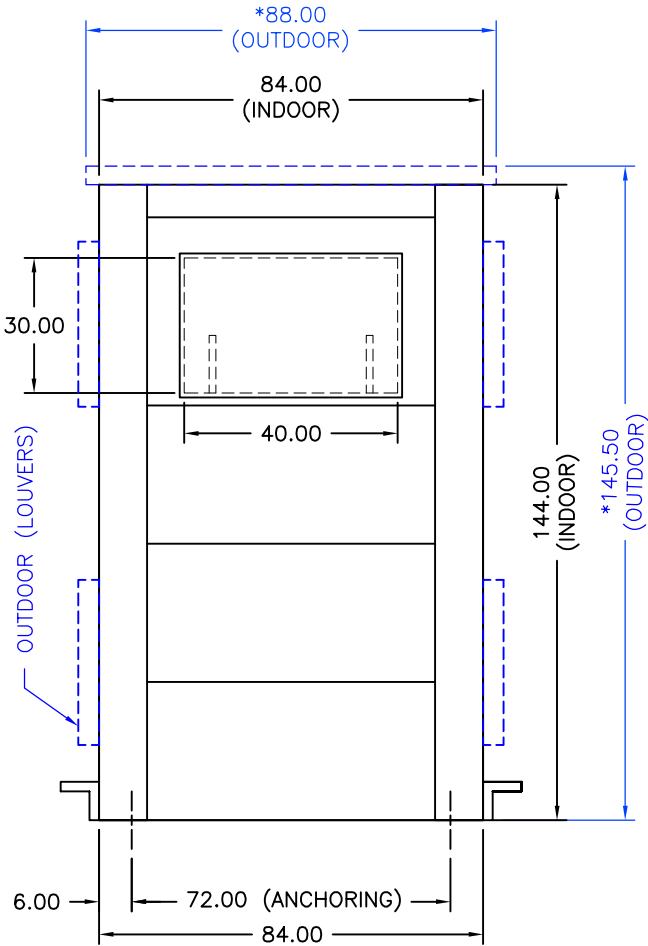

- NOTES
- 1) THIS DRAWING IS NOT FOR CONSTRUCTION PURPOSES.
 - 2) K FACTOR MIGHT CHANGE CASE DIMENSION.
 - 3) TRANSFORMERS ARE MANUFACTURED AND TESTED PER APPLICABLE ANSI, NEMA AND IEEE STDS, LATEST REVISION.
 - 4) UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN INCHES WITH $\pm 0.25"$ TOLERANCE.
 - 5) TRANSFORMER IS U.L. LISTED.
 - 6) TRANSFORMER NOT TO BE INSTALLED IN PUBLIC ACCESS AREAS OTHERWISE IT MUST BE FENCED OR ISOLATED.
 - 7) WEIGHTS, DIMENSIONS & CONSTRUCTION MAY CHANGE WITHOUT PRIOR NOTICE.
 - 8) FOR LV WYE CONNECTION ONLY.

S.O. NO: —
DWG FOR: ☐ RECORD ☐ APPROVAL ☐ QUOTE
CUST/JOB NAME: -
CUST ORDER NO: -
SERIAL NO: -
ID TAG: -
KVA: -
HIGH VOLTAGE: -
LOW VOLTAGE: -
HV TAPS: -
HV-KV BIL: -
LV-KV BIL: -
PHASE: -
FREQ-HZ: -
TEMP RISE-°C: -
COOLING CLASS: -
INSULATION CLASS: -
WINDING COND: -
PAINT/COATING: -
APPRX WT-LBS: -
HV COORD: -
LV COORD: -

REVISIONS	PAGE 1 OF 1	SCALE: NONE	TITLE: DRY TRANSFORMER OUTLINE --- DRY TYPE UNIT SUBSTATION	
	BY	DATE		
	MECH: LU	06/18/26		
	ELECT:			
		APPD:		
				CAD NO. 14415684U REV. -